

### SCHEDULE 3

## PART II


### PEDESTRIAN DEMAND UNIT

---

Note 1	The figures shall be each 100 mm high (minimum) and of the colour and type shown in diagram 4002 in the 1994 Regulations
	The direction of the GREEN figure may be reversed.
	More than one RED and GREEN figure may be provided.
Note 2	The legend may be varied to “Push button Stand on mat Wait for signal”
	or another legend approved by the Secretary of State.

---

Status: This is the original version (as it was originally made).

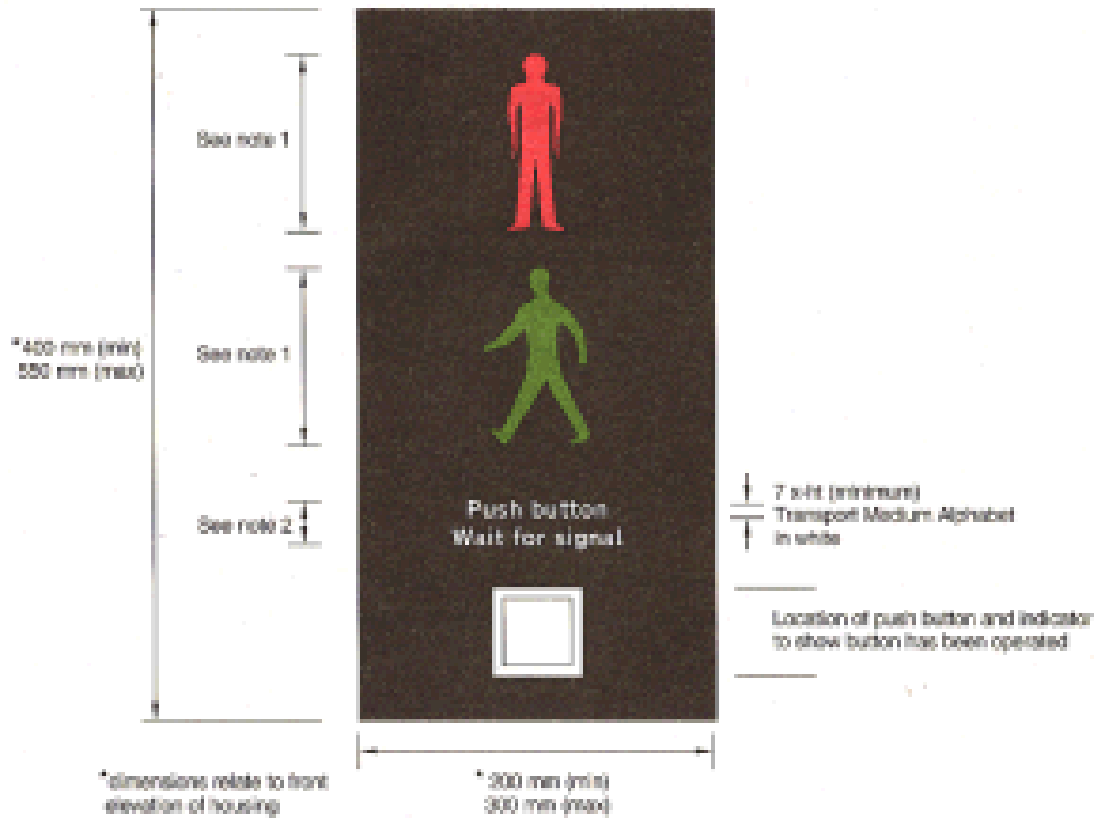

Background colour of demand unit face to be black. All other external surfaces yellow.  
The demand unit face need not be flat, and may comprise more than one unit.